



CONCRETE ENCASEMENT SHALL HAVE
A MINIMUM OF 6" FROM PIPE TO
OUTSIDE EDGE OF CONCRETE

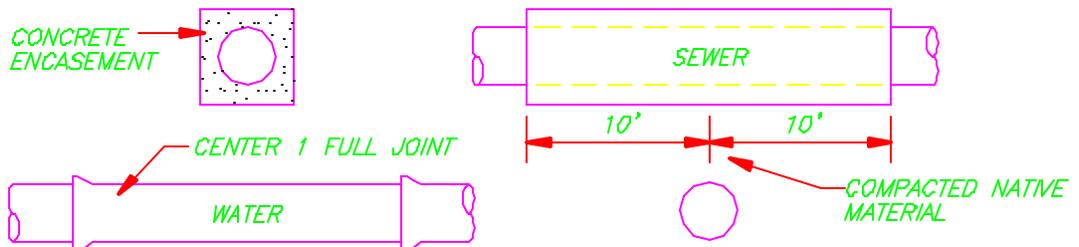

CONDITION #1: NEW WATER MAIN BELOW EXIST. SEWER MAIN

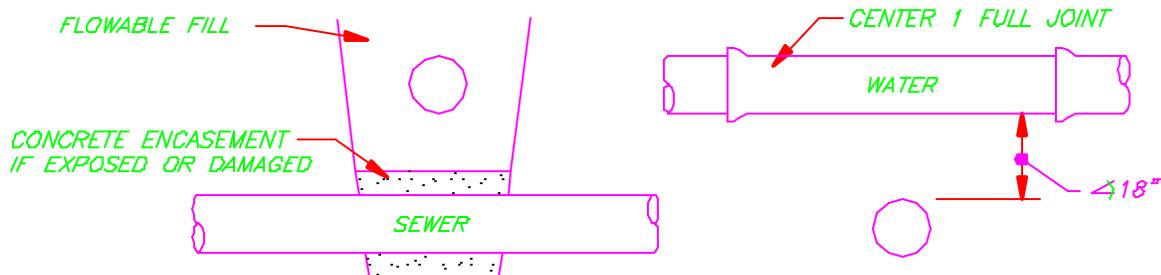

CONDITION #2: NEW WATER MAIN LESS THAN 18" ABOVE EXIST. SEWER MAIN

- 1) SEWER/WATER LINE TO BE CONSTRUCTED OF ONE JOINT (18" MINIMUM) OF C-900 PVC, DR-18 PIPE, CENTERED ON SEWER/WATER LINE FOR PERPENDICULAR CROSSING. FOR SKEW CROSSINGS, USE C-900 PIPE UNTIL HORIZONTAL SEPARATION EXCEEDS 10'.

WATER / SEWER CROSSING

WATER/SEWER
CROSSING DETAIL

TOWN OF NEW CASTLE

NOT TO SCALE

DWG: SW-60